


AKH-0.66 III Current transformer


1. Product feature

Vertical square hole type, they can pass through 1-3 bar bus. Not only they possess features of type I, II, but also can be used for electric metering of power supply, and matched with current relay to do protection.





This product meet the requirements of GB20840.2-2014(Equivalent IEC61869-2:2012,MOD), and have achieved CE certificate.

2. Explanation for type

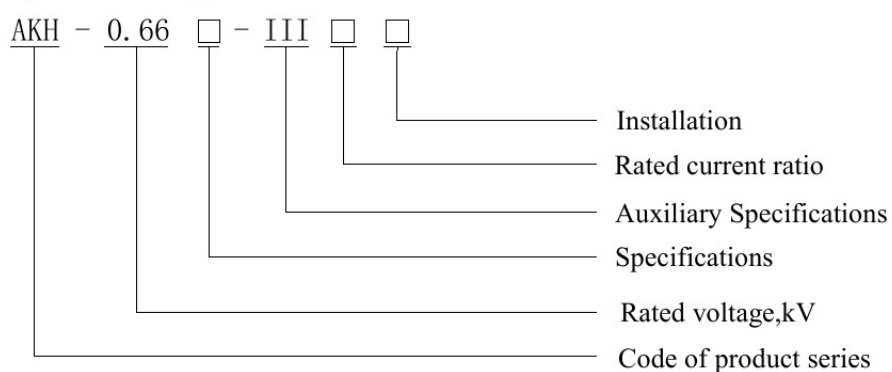

3. Spec. and size

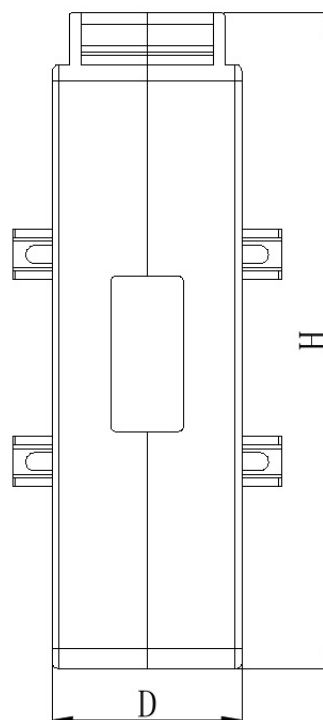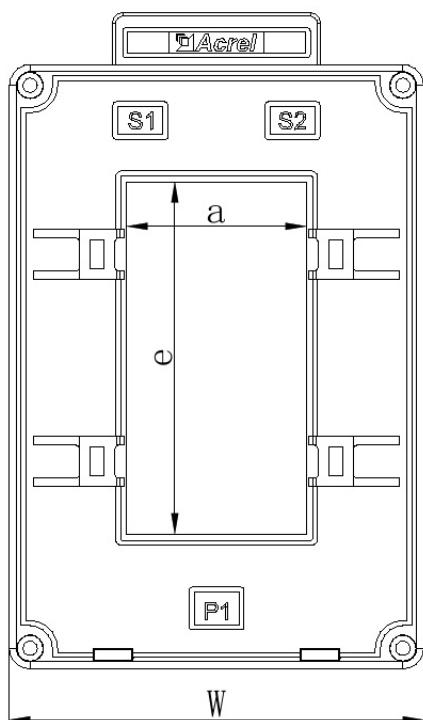

MALAYSIA SALES CONTACT

Jack Ren | Acrel Co., Ltd.

Phone / WhatsApp / WeChat: +86 18702113209

Email: renjiahao2026@gmail.com

www.acrel.my

Malaysia sales details added; technical content unchanged.

Size (mm) Type	Outline size			Through size			Mounting size		Tolerance
	W	H	D	Φ	a	e	M	N	
60III	117	147	55	/	52	62	/	/	±2
80III	117	167	55	/	52	82	/	/	
100III	120	190	55	/	52	102	/	/	
130III	125	224	55	/	52	132	/	/	

4. Cross-reference tables of spec. –parameter

Specification	Rated current ratio (A)	Precision degree and corresponding rated load (VA/ Ω)		Straight-thro ugh tums	Bus spec(mm)/ number	Installati on
		0. 2	0. 5			
	200-300/5 (1)	/	2. 5	1	60×10/ 1-3	E
	400/5 (1)	/	5	1		
	500-800/5 (1)	/	10	1		
	1000/5 (1)	10	/	1		
	1200-1500/5 (1)	15	/	1		
	2000/5 (1)	20	/	1		
	2500/5 (1)	30	/	1		
	300-400/5 (1)	/	5	1	80×10/ 1-3	
	500-800/5 (1)	/	10	1		
	1000/5 (1)	10	/	1		
	1200-1500/5 (1)	15	/	1		
	2000/5 (1)	20	/	1		
	2500-3000/5 (1)	30	/	1		
	600-800/5 (1)	/	10	1	100×10/ 1-3	
	1000/5 (1)	10	/	1		
	1200-1500/5 (1)	15	/	1		
	2000/5 (1)	20	/	1		
	2500-4000/5 (1)	30	/	1		
130III	2000/5 (1)	20	/	1	130×10/1-3	
	2500-5000/5 (1)	30	/	1	125×10/1-3	

MALAYSIA SALES CONTACT

Jack Ren | Acrel Co., Ltd.

Phone / WhatsApp / WeChat: +86 18702113209

Email: renjiahao2026@gmail.com

www.acrel.my



Malaysia sales details added; technical content unchanged.

5. Technical indicators

- Rated operation voltage AC 0.66kV(Equivalent AC 0.69kV,GB156-2017)
- Rated frequency 50-60Hz
- Ambient air temperature -30℃-70℃
- Height above sea level $\leq$ 3000m
- Power frequency withstand voltage 3000v/1min 50Hz
- Used in place without direct rain and snow,without severe pollution and acute shock
- The rated current of the primary equipment or the maximum load current of the line should not be greater than 2 / 3 of the rated primary current of the current transformer

6. Installation

E:

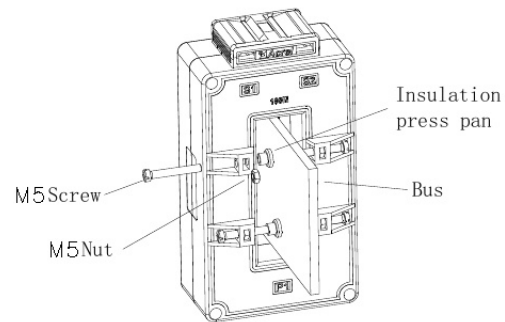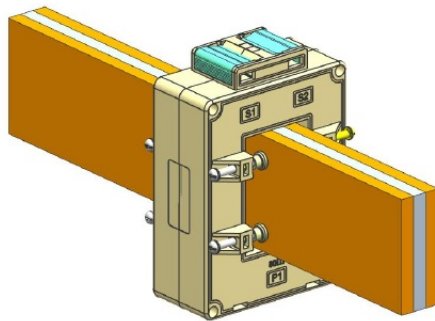

E.Fixed by generatrix

7. Design and test standards

No.	Name	Testing condition	Measuring instrument	Product Verification Cycle	Product testing standards
1	Surface, Terminal mark	Temperature: 20-25℃ Humidity: 50-65%	HLS-50G2 Standard Current Transformer、 HES-1 Digital Transformer Verification FY47 Current Transformer Load Cases FY49Current Transformer Load Cases LK2673 Withstand Voltage Tester ZC25-4 Insulation Resistance Shaking Instrument	2 Years	GB 20840. 2-2014 《Current Transformer》 JJG313-2010 Verification Procedure
2	Power frequency Withstand voltage				
3	Insulation resistance				
4	Error testing				

MALAYSIA SALES CONTACT

Jack Ren | Acrel Co., Ltd.

Phone / WhatsApp / WeChat: +86 18702113209

Email: renjiahao2026@gmail.com

www.acrel.my

Malaysia sales details added; technical content unchanged.